


(F)17-V Surface Vertical Device

Surface Vertical Rod Panic and Fire Exit Device, Wood Door, LHR Shown, RHR Opposite

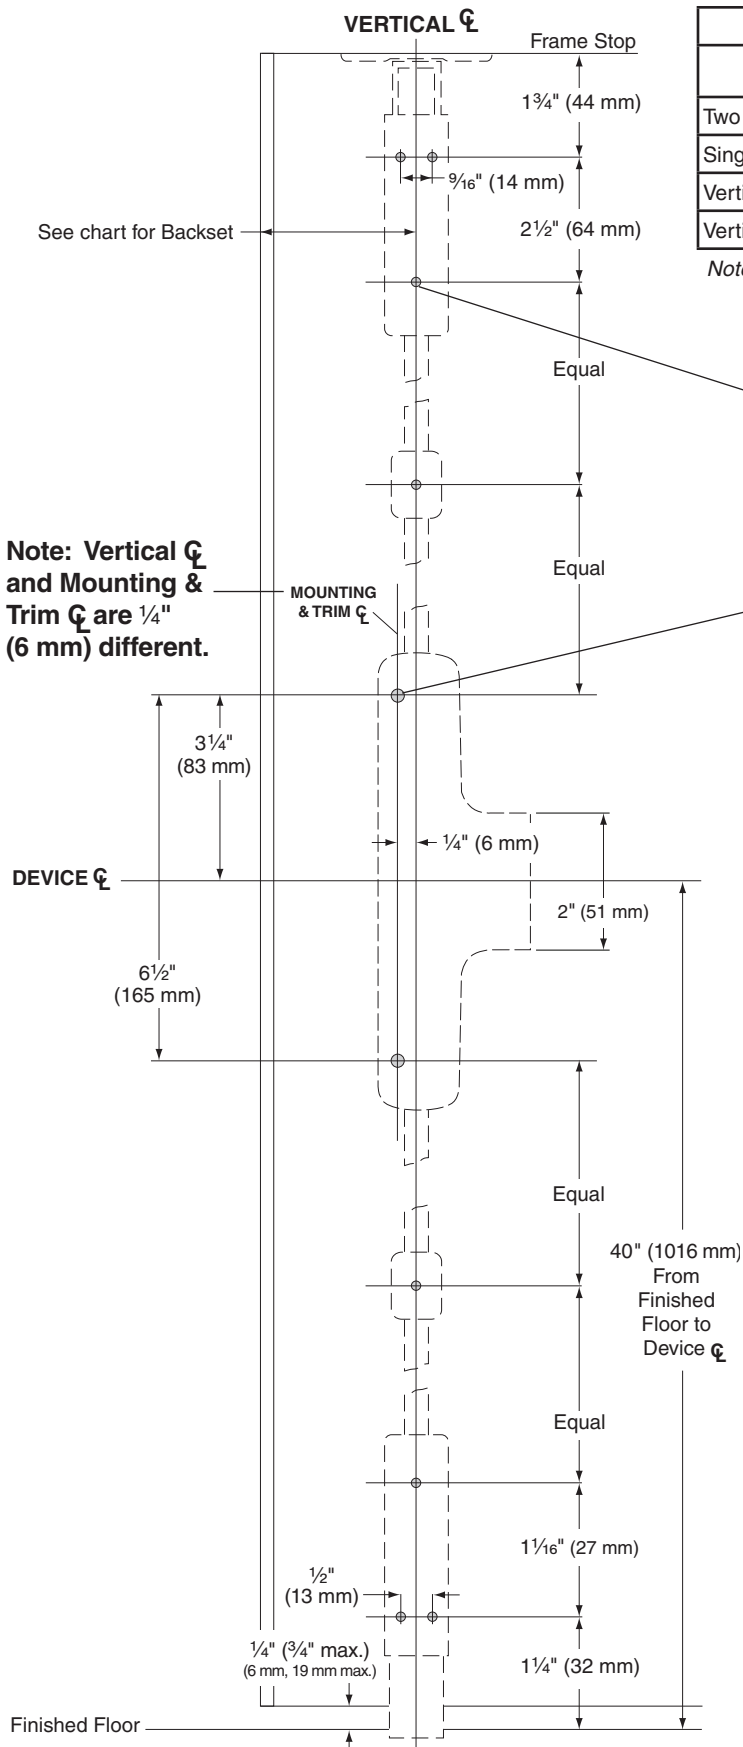

BACKSET		
Installation	1 3/4\" Min. Stile	3\" to Flush Door
Two Vertical Rod Devices	1 1/4"	2 1/4"
Single Vertical Rod Device	1 1/4"	2 1/4"
Vertical Rod x Rim Device (with 571 Strike)	—	2 5/16"
Vertical Rod x Rim Device (with 571-A Strike)	—	1 3/16"

Note: 571 and 571-A strikes are not approved for fire rated applications.

- Drill 9/64" (4 mm) diameter x 1 1/4" (32 mm) deep, or refer to Template W-4014 for sexbolt preparation (8 holes).
 - **Fire rated devices require sexbolts.**
- For exit only device or device with non-thrulbolting trim, drill 3/16" (4 mm) diameter hole x 1 1/4" (32 mm) deep, or refer to Template W-4014 for sexbolt preparation (2 holes).
 - For device with thrulbolting trim, refer to trim template.
 - **Fire rated devices require sexbolts.**

- For Less Bottom Rod (LBR) application (20 minute rating), refer to Template W-5494 auxiliary fire latch preparation and omit bottom latch preparation.
- For outside trim, see trim template for door preparation.
- Top and bottom latches and bolts to be prepared at time of device installation.

TEMPLATE
W-1128-a